

## E. coli Sampling Results

### Response from Dogs

- ◊ 0 - No Dog Alert
- ◊ 1 - 1 Dog Alert
- ◊ 2 - Both Dogs Alert

Environmental Canine Services, 2016

### E. coli Sample (per 100 ml)

- 800 - 10000
- 10,000 - 25,000
- 25,001 - 2,400,000

Collected 2016


### Number of Times Water Samples Tested for E. coli >10,000\* (per 100 ml)

- 0
- 1
- 2 - 5
- 6 - 24

Collected 2011 & 2012

### BASE LAYERS

- Subwatershed
- Municipal Boundary
- Drain
- Stream
- Sewer line

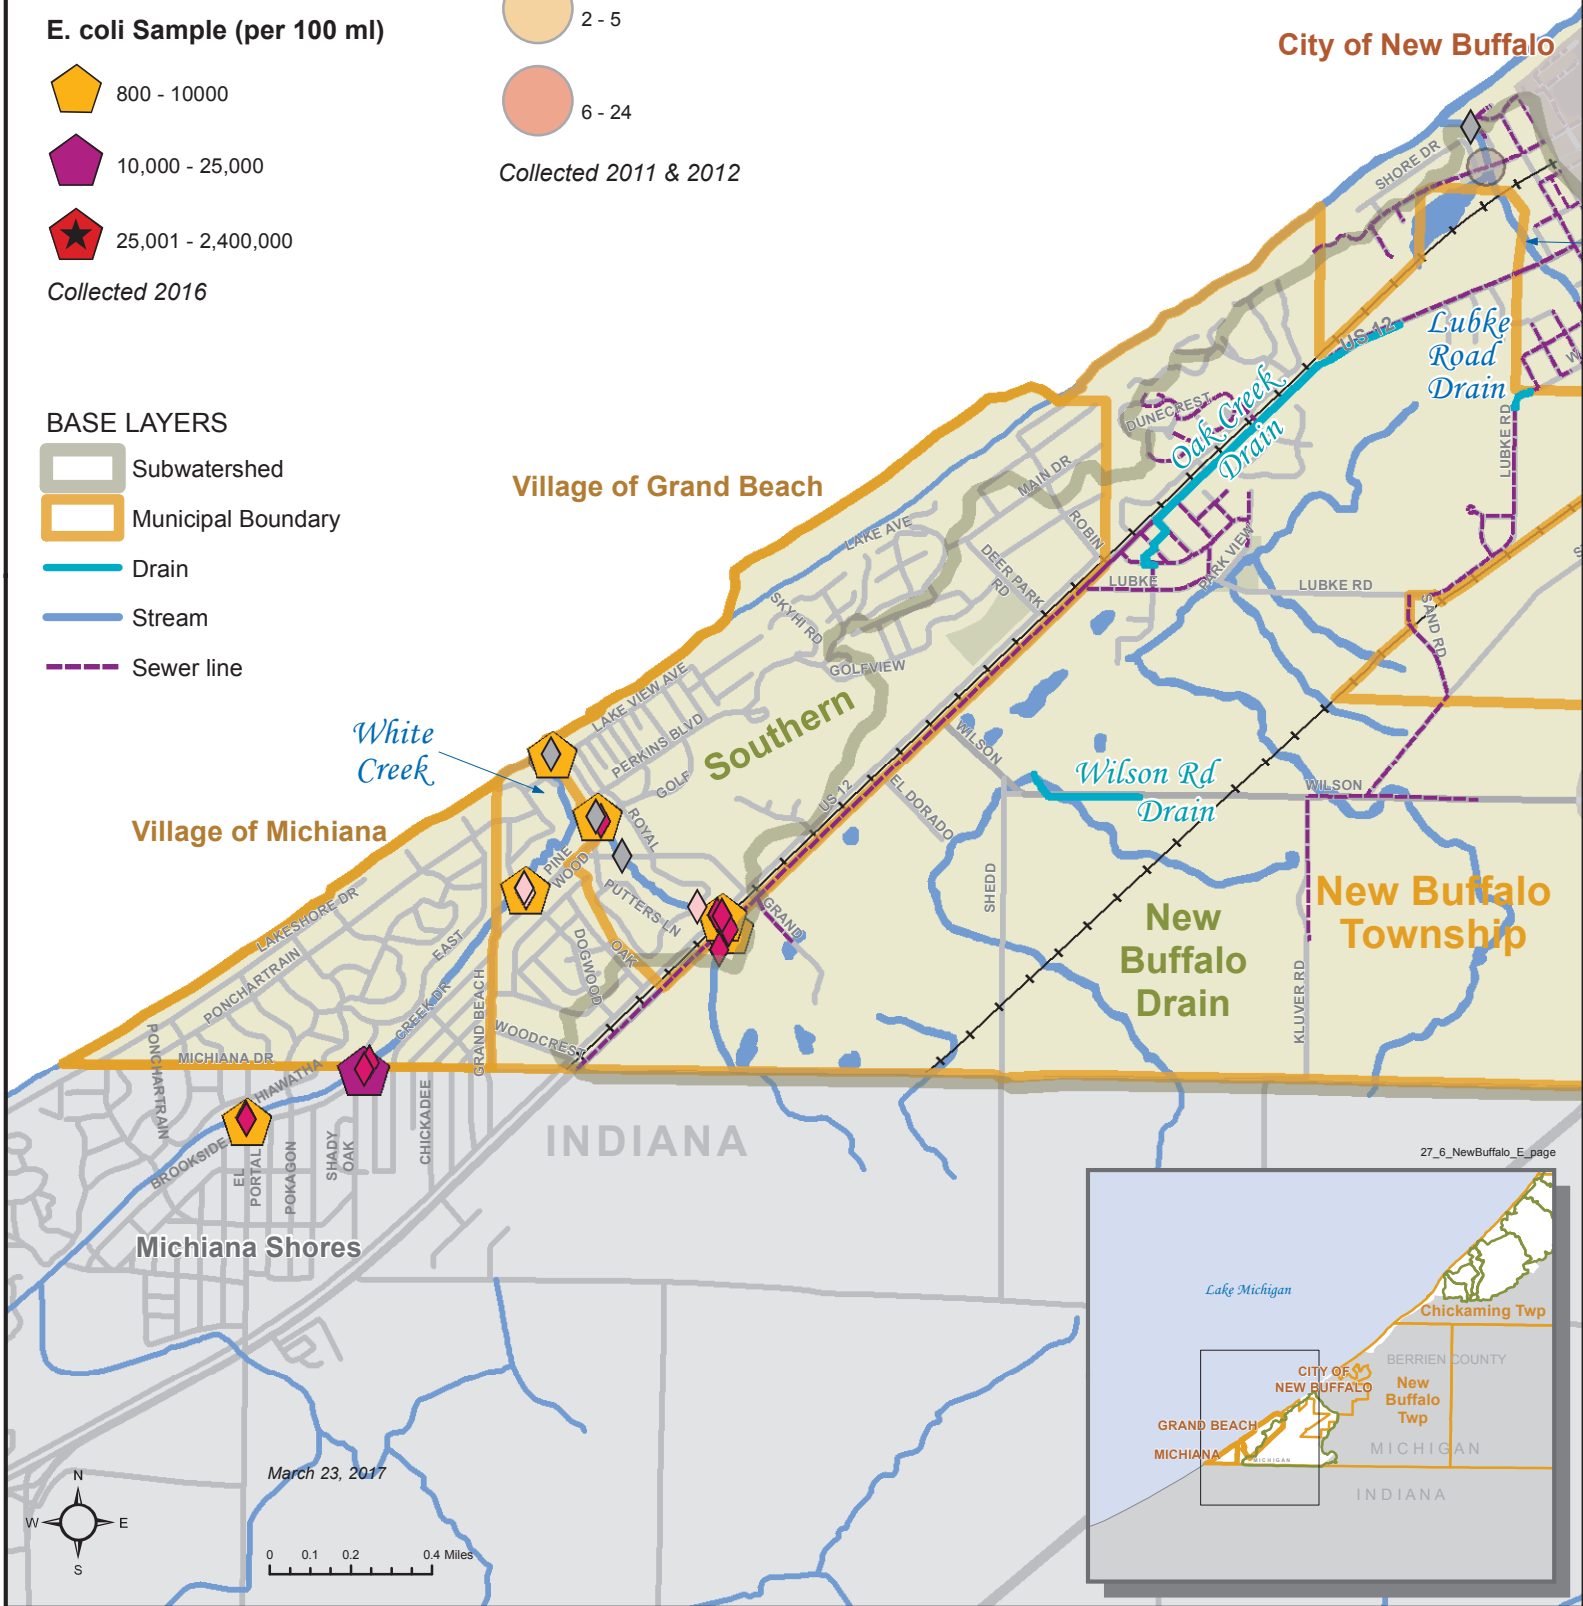

City of New Buffalo



Village of Grand Beach

Village of Michiana

New Buffalo Township

INDIANA

27\_6\_NewBuffalo\_E\_page



March 23, 2017